

SIGNALOMFORMER FOR SPENNING

P20Z01321000

Signalomformer 0-60VAC/4-20mA. 24 VAC/DC drift

- Inn: 0-600 V AC eller 0-400 V DC (6 omr)
- Ut: 4-20 mA eller 0-10 V
- 20-40 VAC/DC eller 90-250 VAC/DC
- Eks: 0-100 V DC, 0-250 V AC



PRODUKTBESKRIVELSE

Signalomformer / Måleverdiomformer for AC eller DC spenning med enten 4-20 mA eller 0-10 V ut.

Serien finnes oppdelt i flere modeller:

0-60, 0-100, 0-150, 0-250, 0-400, 0-500 og 0-600 V AC .

+/-100, +/-250, +/-400, 0-100, 0-250, 0-400 V DC.

Signalomformerens bestilles med ønsket inn- og utsignal. Ingen ytterligere justering behøves, noe som gjør installasjonen rask og enkel. Det finnes LED indikering for tilkoblet driftsspenning.

To valg av driftsspenning finnes: 20-40 VAC/20-60 VDC eller 85-253 VAC/90-260 VDC.

Vi viser bare et utvalg på vår nettside. Kontakt oss for andre innspenninger og utsignal.

TEKNISKE DATA

INNGANGSDATA

Måleområde, spenning	0-60 VAC
Måleområde	0-60 VAC

UTGANGSDATA

Last maks (4-20 mA)	500 Ω
---------------------	--------------






MEKANISK DATA

IP-klasse	IP20
-----------	------

Vekt	0,125 kg
Tilkoblingsareal maks.	1,5 mm ²

GENERELL DATA

Driftspenning DC maks.	60 V
Driftspenning DC min.	20 V
Driftspenning AC min.	20 V
Driftspenning AC maks.	40 V
Effektforbruk	4 VA
Temperaturområde fra	-20 °C
Temperaturområde til	55 °C

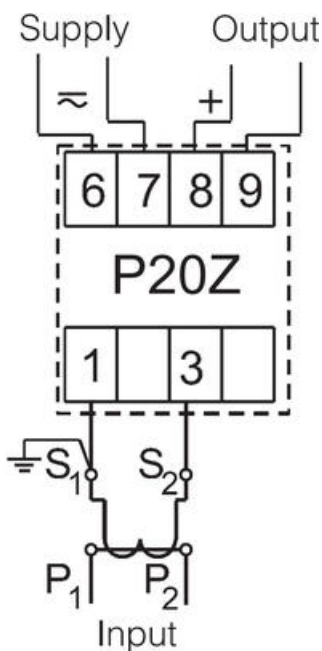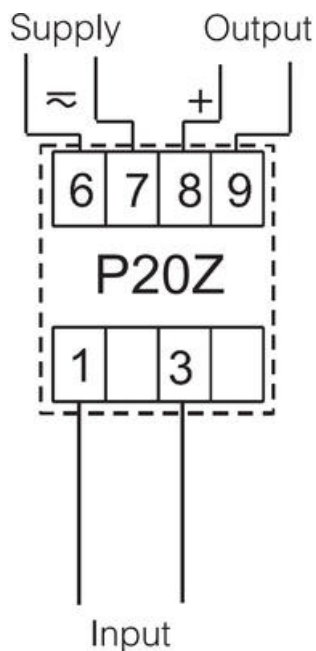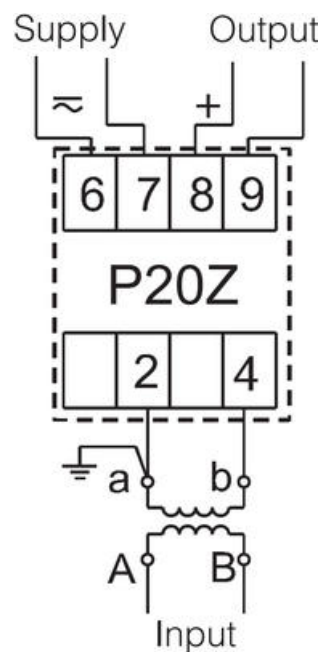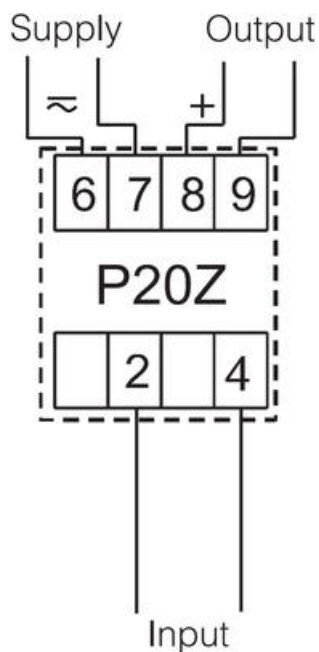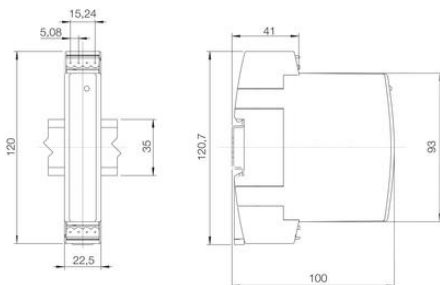

EXECUTION CODES

TRANSUCER	P20Z	-	XX	X	X	X	XX	X
Input range								
0... 60 V			01					
0... 100 V			02					
0... 150 V			03					
0... 250 V			04					
0... 400 V			05					
0... 500 V			06					
0... 600 V			07					
0... 1 A			08					
0... 5 A			09					
Output range								
0... 5 mA			1					
0... 20 mA			2					
4... 20 mA			3					
0... 10 V			4					
Supply voltage								
85...253 V a.c./d.c.			1					
20...40 V a.c./d.c.			2					
Kind of terminals								
inseparable with screws			1					
socket-plug with screws			2					
Kind of execution								
standard							00	
custom-made							XX	
Acceptance tests								
without additional requirements							8	
with an extra quality inspection certificate							7	
acc. user's agreement *							X	

